




## INSTRUCTIONS FOR THE DECOMMISSIONING OF SEPTIC TANKS

### When is decommissioning required?

When existing premises are connected to the sewer or new septic systems are installed, all redundant septic tank(s) are to be decommissioned using the procedure detailed below. This is to ensure that the redundant tank(s) do not cause any future public health or environmental problems.

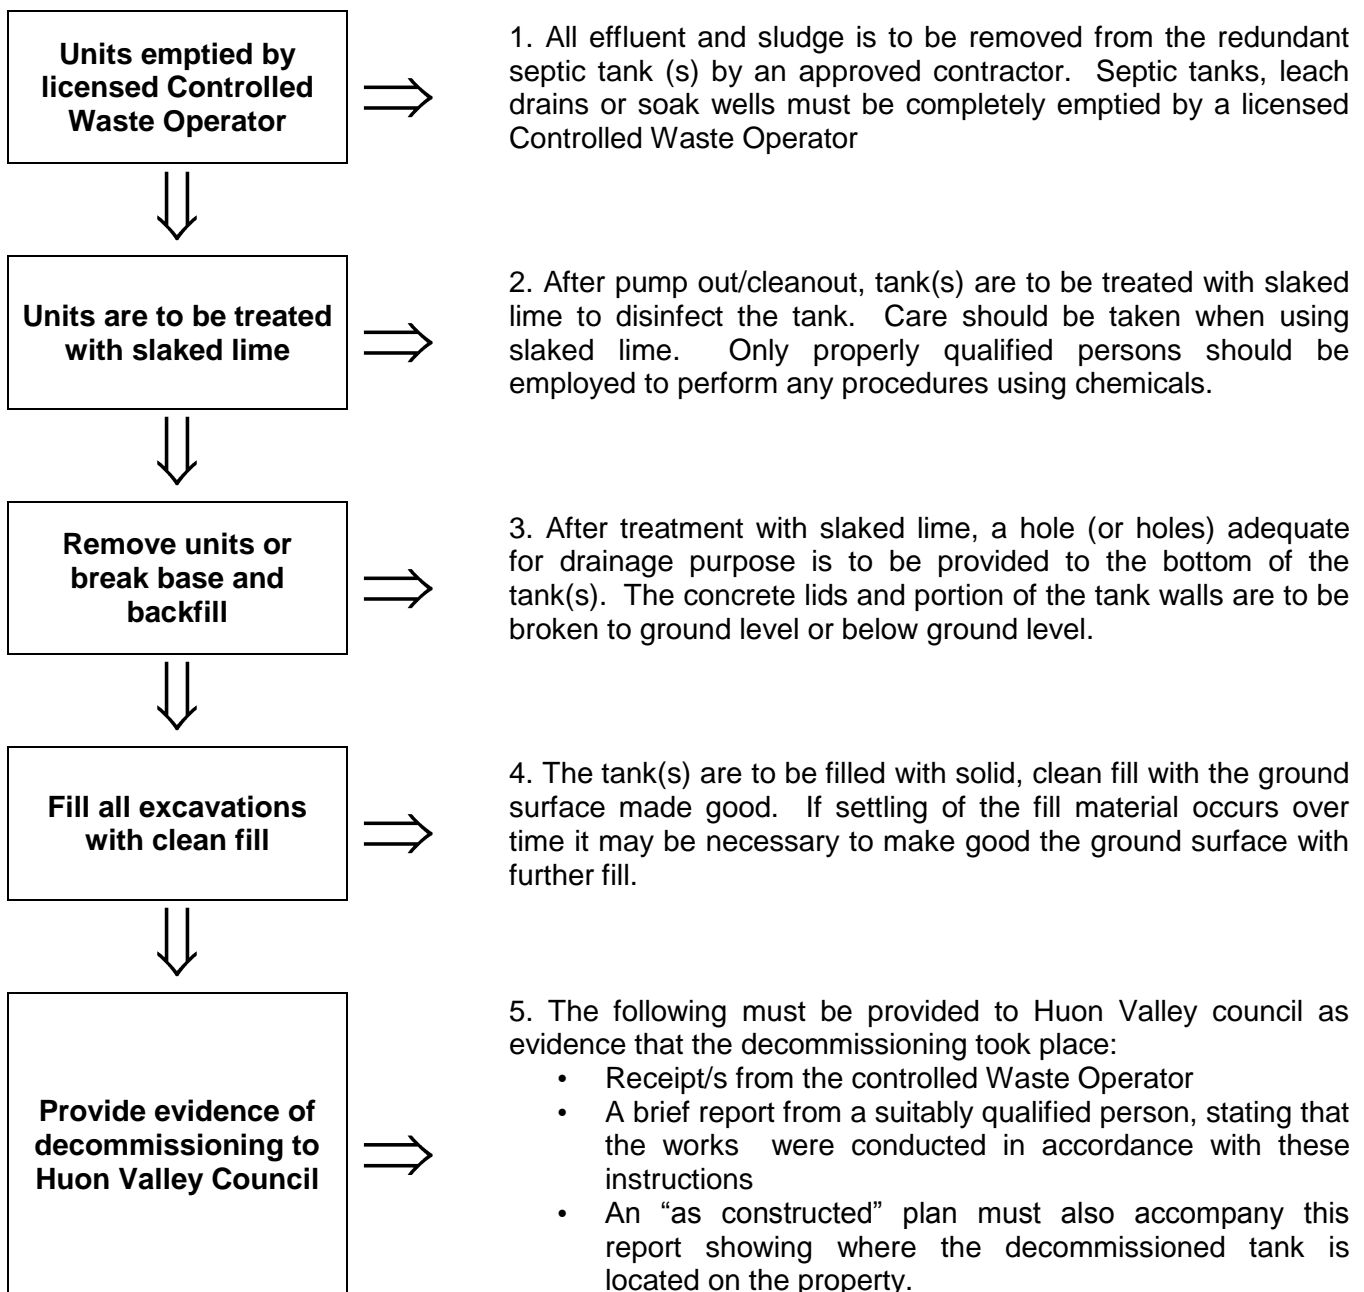

**This is important so that up to date records of the property can be kept by Council**